




SEPARATION DISTANCES BETWEEN SEWERS ASSOCIATED WITH THE WORKS FROM OTHER UTILITY PIPES AND ACCESSORIES SHALL BE IN ACCORDANCE WITH SECTION 3.5.9 TO 3.5.21 OF THE CODE OF PRACTICE. SEPARATION DISTANCES FOR ALL NEW INSTALLATIONS FROM EXISTING IRISH WATER PIPES SHALL BE AS OUTLINED IN SECTION 3.20 OF THE CODE OF PRACTICE.

SPECIFIC SEPARATION CLEARANCE DISTANCES IN EXCESS OF THESE MINIMA SHALL BE PROVIDED FOR SERVICES SUCH AS GAS, ELECTRICITY, FIBRE-OPTIC OR OIL FILLED CABLES AS THE CASE MAY BE.
THE PARTICULAR UTILITY PROVIDERS SHALL BE CONSULTED TO DETERMINE THESE MINIMUM SEPARATIC DISTANCES AND EVIDENCE OF THIS CONSULTATION, WITH THE SPECIFIED SEPARATION DISTANCES,

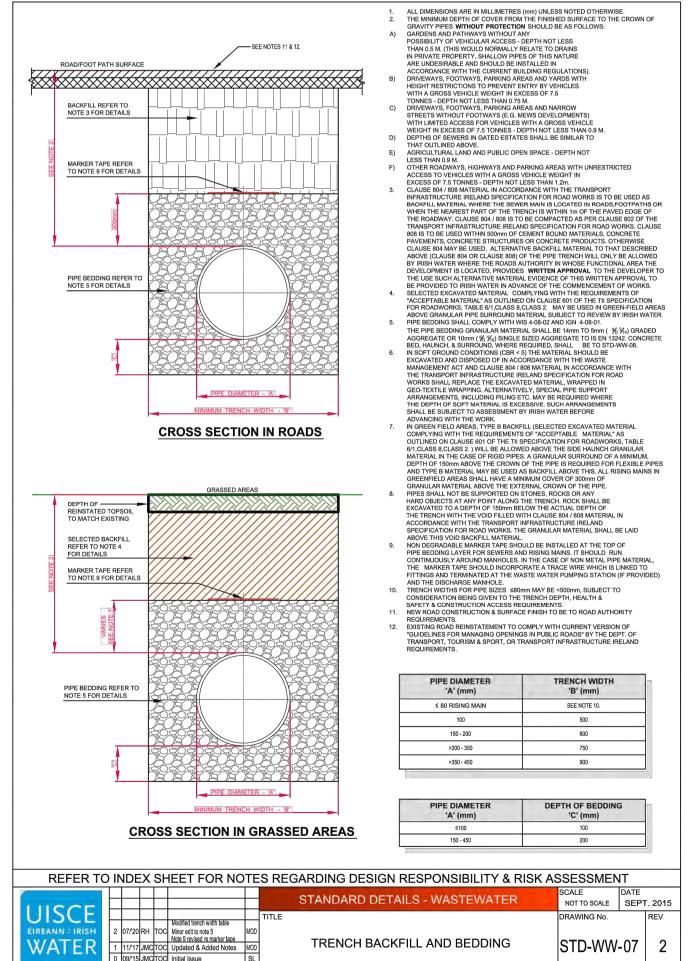

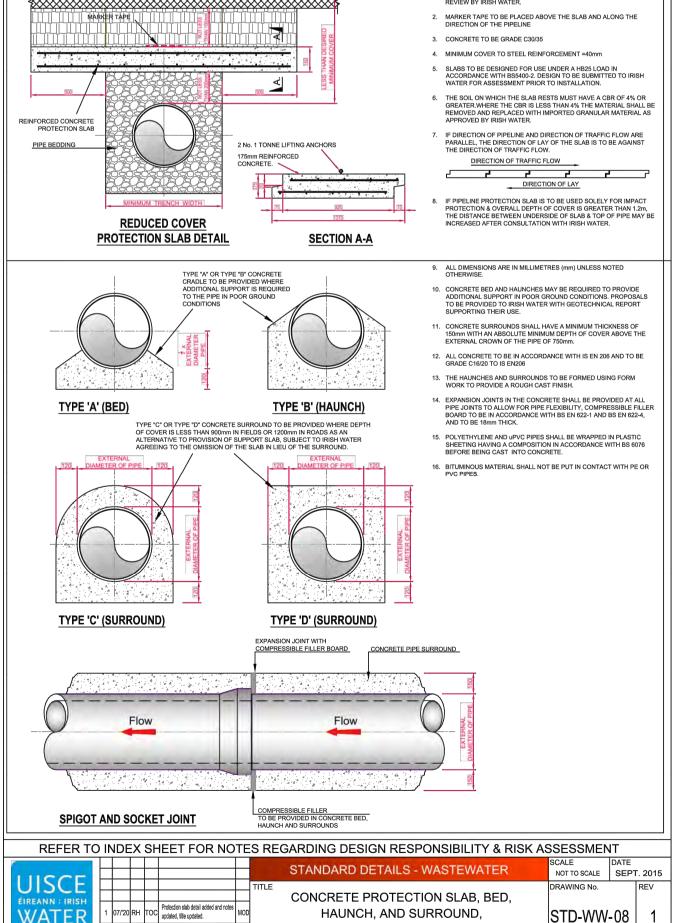

TO WASTEWATER PIPES

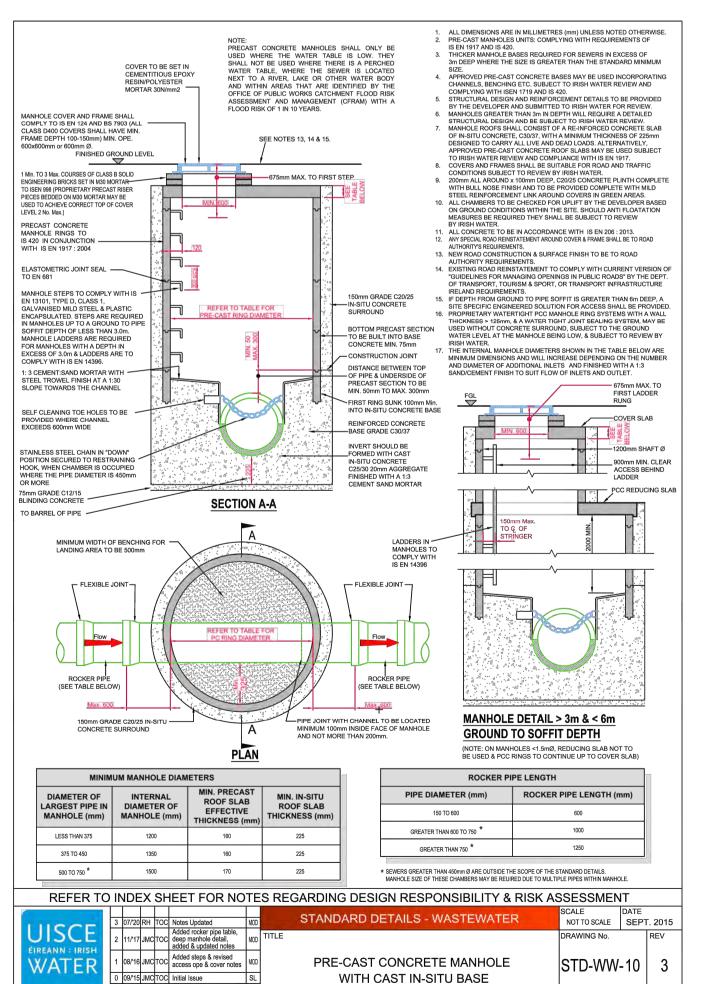



STD-WW-01 Waste water service connection responsibility

STD-WW-03 Drain & Service connection pipework

STD-WW-04 Typical Sewer/ Service pipe connection

STD-WW-05 Typical Service layout indicating seperation distances

STD-WW-07 Trench Backfill & Bedding

STD-WW-08 Concrete bed, Haunch & surround to wastewater pipes

STD-WW-10 Pre-cast concrete manhole

STD-WW-12 Backdrop manholes

STD-WW-13 Private side inspection chamber

STD-WW-14 Thrust blocks for rising main

STD-WW-15 Scour valve chamber (Foul rising main <200mmØ)

STD-WW-17 Sluice valve details for rising mains Polyethylene (P.E.) Pipe (<200mmØ)

STD-WW-18 Air valve chamber (Foul rising main <200mmØ)


Refer to dwg no. 6159-5020 for plan layout



Joyce House | 021 4871781 Barrack Square info@dosa.ie Ballincollig www.dosa.ie Co Cork P31 KP84

© THIS DRAWING IS COPYRIGHT, NO PART OF THIS DOCUMENT MAY BE RE-PRODUCED OR TRANSMITTED IN ANY FORM OR STORED IN ANY RETRIEVAL SYSTEM OF ANY NATURE WITHOUT THE WRITTEN PERMISSION OF THE ENGINEER AS COPYRIGHT HOLDER EXCEPT AS AGREED FOR USE ON THE PROJECT FOR WHICH THE DOCUMENT WAS ORIGINALLY ISSUED.

1/15 JMC TOC Initial Issue

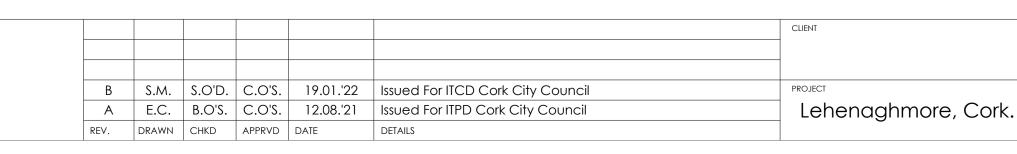

STD-WW-08

Proposed Wastewater Details (Sheet 1 of 2)

PROJECT NO. DRAWING NO. STATUS/ISSUE 6159 _ 5025 _ B N.T.S. Α1